

CALIFORNIA



Coordinated Response Exercise[®]

PIPELINE SAFETY TRAINING FOR FIRST RESPONDERS



PROGRAM GUIDE

Overview

Pipeline Safety

Exercise Outline

Emergency Response Guidebook

NENA Pipeline Emergency Operations

Signs Of A Pipeline Release

High Consequence Areas Identification

Pipeline Industry ER Initiatives

Pipeline Damage Reporting Law

2024

EMERGENCY CONTACT LIST

| <u>COMPANY</u> | <u>EMERGENCY NUMBER</u> |
|---|-------------------------|
| Air Products, LLC | 1-800-572-6521 |
| California Natural Resources Group (CalNRG) | 1-888-664-4435 |
| California Resources Corporation - Central Valley | 1-661-763-6363 |
| or | 1-661-763-6911 |
| California Resources Corporation - Elk Hills, LLC | 1-661-763-6363 |
| or | 1-661-763-6911 |
| Chevron Pipeline & Power..... | 1-800-762-3404 |
| Crimson Pipeline, LLC..... | 1-866-351-7473 |
| DCOR, LLC | 1-888-225-1522 |
| ExxonMobil Pipeline Company..... | 1-800-537-5200 |
| Freeport - McMoRan Oil & Gas..... | 1-805-739-9111 |
| Kern Energy..... | 1-661-845-0761 |
| Lodi Gas Storage, L.L.C..... | 1-800-307-1107 |
| Martinez Pipeline Company..... | 1-877-662-4575 |
| Midstream Energy Partners (USA), LLC | 1-866-295-2176 |
| Mojave Pipeline Company, L.L.C. | 1-800-334-8047 |
| NuStar Energy L.P. | 1-800-433-4250 |
| Paramount Pipeline LLC..... | 1-562-244-4508 |
| Phillips 66 Pipeline LLC..... | 1-877-267-2290 |
| Plains Pipeline L.P. | 1-800-708-5071 |
| Sable Offshore Corp. | 1-800-708-5071 |
| Shell Pipeline Company LP..... | 1-800-922-3459 |
| SMUD | 1-855-525-7142 |
| SoCalGas | 1-800-427-2200 |
| SoCal Holding LLC | 1-562-624-3452 |
| THUMS..... | 1-562-624-3452 |
| Tidelands | 1-562-624-3452 |
| Torrance Logistics Company | 1-877-662-4575 |
| TransMontaigne Product Services Inc..... | 1-800-732-8140 |
| Valero Refining Company - California | 1-707-745-7562 |
| Valero - Ultramar | 1-562-491-6803 |
| Vopak Terminal Los Angeles Inc..... | 1-310-549-2221 |
| World Oil Terminals | 1-562-432-1737 |
| Zenith Energy West Coast Terminals LLC..... | 1-866-497-2284 |

Note: The above numbers are for emergency situations.

Additional pipeline operators may exist in your area.

Visit the National Pipeline Mapping System at www.npms.phmsa.dot.gov for companies not listed above.

| <u>ONE-CALL SYSTEM</u> | <u>PHONE NUMBER</u> |
|---|---------------------|
| Underground Service Alert of Southern California (DigAlert) | 1-800-422-4133 |
| USA North 811..... | 1-800-642-2444 |
| National One-Call Referral Number..... | 1-888-258-0808 |
| National One-Call Dialing Number | 811 |

Table of Contents

| | |
|---|----|
| Overview..... | 2 |
| Pipeline Safety..... | 4 |
| Emergency Response Guidebook..... | 11 |
| Emergency Response | 12 |
| NENA Pipeline Emergency Operations - Initial Intake Checklist..... | 14 |
| Signs Of A Pipeline Release / What To Do If A Leak Occurs / Pipeline Emergency..... | 15 |
| High Consequence Areas Identification / Identified Sites..... | 16 |
| Common Ground Alliance Best Practices / Pipelines In Our Community / Training Center..... | 17 |
| Damage Prevention Programs / Pipeline Markers / Call Before You Dig..... | 18 |
| Pipeline Damage Reporting Law / Websites..... | 19 |
| About Paradigm..... | 20 |
| Operator Information..... | 21 |

Pipeline Purpose and Reliability

- Critical national infrastructure
- Over 2.7 million miles of pipeline provide 65% of our nation's energy
- 20 million barrels of liquid product used daily
- 21 trillion cubic feet of natural gas used annually

Safety Initiatives

- Pipeline location
 - Existing right-of-way (ROW)
- ROW encroachment prevention
 - No permanent structures, trees or deeply rooted plants
- Hazard awareness and prevention methods
- Pipeline maintenance activities
 - Cleaning and inspection of pipeline system

Product Hazards and Characteristics

Petroleum (flow rate can be hundreds of thousands of gallons per hour)

- Flammable range may be found anywhere within the hot zone
- H2S can be a by-product of crude oil

| <u>Type 1 Products</u> | <u>Flash Point</u> | <u>Ignition Temperature</u> |
|------------------------|--------------------|-----------------------------|
| Gasoline | - 45 °F | 600 °F |
| Jet Fuel | 100 °F | 410 °F |
| Kerosene | 120 °F | 425 °F |
| Diesel Fuel | 155 °F | varies |
| Crude Oil | 25 °F | varies |

Natural Gas (flow rate can be hundreds of thousands of cubic feet per hour)

- Flammable range may be found anywhere within the hot zone
- Rises and dissipates relatively quickly
- H2S can be a by-product of natural gas – PPM = PARTS PER MILLION
 - 0.02 PPM Odor threshold
 - 10.0 PPM Eye irritation
 - 100 PPM Headache, dizziness, coughing, vomiting
 - 200-300 PPM Respiratory inflammation within 1 hour of exposure
 - 500-700 PPM Loss of consciousness/possible death in 30-60 min.
 - 700-900 PPM Rapid loss of consciousness; death possible
 - Over 1000 PPM Unconsciousness in seconds; death in minutes
- Incomplete combustion of natural gas may release carbon monoxide
- Storage facilities may be present around populated areas/can be depleted production facilities or underground caverns
- Gas travel may be outside the containment vessel along the natural cavern between the pipe and soil

Propane, Butane and Other Similar Products

- Flammable range may be found anywhere within the hot zone
- Products cool rapidly to sub-zero temperatures once outside the containment vessel
- Vapor clouds may be white or clear

| <u>Type 3 Products</u> | <u>Flash Point</u> | <u>Ignition Temperature</u> |
|------------------------|--------------------|-----------------------------|
| Propane | - 150 °F | 920-1120 °F |
| Butane | - 60 °F | 725-850 °F |

Line Pressure Hazards

- Transmission pipelines – steel (*high pressure: average 800-1200psi*)
- Local gas pipeline transmission – steel (*high pressure: average 200-1000psi*)
- Local gas mains and services – steel and/or plastic (*low to medium pressure*)
 - Mains: up to 300psi
 - Service lines: up to regulator
 - Average 30-45psi and below
 - Can be up to 60-100psi in some areas
- At regulator into dwelling: ounces of pressure

Leak Recognition and Response

- Sight, sound, smell – indicators vary depending on product
- Diesel engines – fluctuating RPMs
- Black, dark brown or clear liquids/dirt blowing into air/peculiar odors/dead insects around gas line/dead vegetation
- Rainbow sheen on the water/mud or water bubbling up/frozen area on ground/frozen area around gas meter
- Any sign, gut feeling or hunch should be respected and taken seriously
- Take appropriate safety actions ASAP

High Consequence Area (HCA) Regulation

- Defined by pipeline regulations 192 and 195
- Requires specialized communication and planning between responders and pipeline/gas personnel
- May necessitate detailed information from local response agencies to identify HCAs in area

Emergency Response Basics

- Always follow pipeline/gas company recommendations – pipeline representatives may need escort to incident site
- Advance preparation
 - Get to know your pipeline operators/tour their facilities if possible
 - Participate in their field exercises/request on-site training where available
 - Develop response plans and practice
- Planning partners
 - Pipeline & local gas companies
 - Police – local/state/sheriff
 - Fire companies/HAZMAT/ambulance/hospitals/Red Cross
 - LEPC/EMA/public officials
 - Environmental management/Department of Natural Resources
 - Army Corps of Engineers/other military officials
 - Other utilities
- Risk considerations
 - Type/volume/pressure/location/geography of product
 - Environmental factors – wind, fog, temperature, humidity
 - Other utility emergencies
- Incident response
 - Always approach from upwind/park vehicle a safe distance away/if vehicle stalls – DO NOT attempt to restart
 - Gather information/establish incident command/identify command structure
 - Initiate communications with pipeline/gas company representative ASAP
 - Control/deny entry: vehicle, boat, train, aircraft, foot traffic, media – refer all media questions to pipeline/gas reps
- Extinguish fires only
 - To aid in rescue or evacuation
 - To protect exposures
 - When controllable amounts of vapor or liquid present
- Incident notification – pipeline control center or local gas company number on warning marker
 - In **Pipeline Emergency Response Planning Information Manual**
 - Emergency contact list in **Program Guide**
 - Call immediately/provide detailed incident information
- Pipeline security – assist by noting activity on pipeline/gas facilities
 - Report abnormal activities around facilities
 - Suspicious excavation/abandoned vehicles/non-company personnel/non-company vehicles
 - Freshly disturbed soil/perimeter abnormalities

One-Call


- One-Call centers are not responsible for marking lines
- Each state has different One-Call laws. Familiarize yourself with the state you are working in
- Not all states require facility owners to be members of a One-Call
- You may have to contact some facility owners on your own if they are not One-Call members
- In some states, homeowners must call before they dig just like professional excavators

CORE Pipeline Emergency Response Training

First Responders and Emergency Personnel

CORE
COORDINATED RESPONSE EXERCISE

Instructor:



THE EXERCISES ARE SO CONDUCTED AS TO BE APPROVED BY AN OFFICER EMPLOYED BY NEVADA COUNTY, CALIFORNIA. THE EXERCISES CONDUCTED BY THE INSTRUCTOR OR PARTICIPANT AT OTHER LOCATIONS, TIMES AND ON OTHER DEVICES, ARE NOT APPROVED BY NEVADA COUNTY, CALIFORNIA. TRADEMARK AND/OR SERVICE MARKS ARE OWNED BY THEIR RESPECTIVE OWNERS. © 2014 PARADIGM PIPELINE SAFETY TRAINING. ALL RIGHTS RESERVED.

CORE Local Operator Information*

- Operator and/or company name
- Pipeline systems and products
- Location of pipelines
- Pipeline size/operating pressure(s)
- Operator Response(s) to a pipeline emergency

*Information in the materials may not represent all pipeline companies in your area.




CORE Coordinated Response Exercise®

- Learn** your roles and responsibilities as emergency responders should a pipeline emergency happen in your jurisdiction. As well as your access to resources.
- Acquaint** you with the operator's ability to respond to a pipeline emergency.
- Identify** the types of pipeline emergencies.
- Plan** how all parties can engage in mutual assistance to minimize hazards to life, property and the environment.

Code of Federal Regulations (CFR): 49 CFR Parts 192 and 195

Roll Calls: Law Enforcement, Fire, EMS, Emergency Management, Division of Forest Service, State & Federal Officials, School Officials, PSAP & Pipeline Operators



CORE Program Resources

ca.pipeline-awareness.com

Paradigm
Pipeline Safety Training


Meeting Materials | Pipeline Operators | Emergency Officials | Public Officials | Facilities

CALIFORNIA PIPELINE AWARENESS


Meeting Materials:

- 2010 Emergency Response Manual
- 2010 Local Operator Guide
- 2010 California State Program Guide
- 2010 CORE 2011 State Program Guide
- 2010 Incident Response Program Guide
- 2010 Emergency Response State Response Guide
- 2010 Incident Response State Response Guide

CORE Program Resources



COORDINATED RESPONSE EXERCISE
Pipeline Safety Training for First Responders
EMERGENCY RESPONSE MANUAL
2024



Carbon Dioxide (CO₂)
Emergency Response
Tactical Guidance Document
Guidance for Responders and Other Personnel to a Pipeline Release of Carbon Dioxide (CO₂)
August 2022

API ICF International

<https://www.ehponline.org/doi/10.1371/journal.pone.0261943>

CORE Integrity Management

Pipeline companies are required to have Integrity Management programs to insure safe and efficient operations:

- Internal and external cleaning and inspection, of the pipeline and affected areas
 - Rights-of-Way and valves
- Supervisory Control and Data Acquisition (SCADA)
- Identification of High-Consequence Areas (HCA)
- Aerial Rights-of-Way Patrols
- Public Awareness Outreach to stakeholders
- Participation as a member of 811
- Operator Qualification (OQ) Training
- Local Distribution Company (LDC)
 - Meter Testing
 - Leak Surveys
 - May also be utilized on transmission pipelines




CORE Pipeline Operators Emergency Response Plans

Natural gas and hazardous liquids

- Notify appropriate fire, police, and other public officials of gas or liquid pipeline emergencies, coordinate planned responses, and actual responses during an emergency
- Identify the type of incident
- Prompt and effective response measures
- Availability of personnel and equipment
- Make safe any actual or potential hazard to life, property, and the environment
- Incident investigation and review

Natural gas (49 CFR 192.615)

- Establish and maintain communication with fire, police, and other public officials
- Direct actions to protect people, then property
- Emergency shutdown to minimize hazard to life, property, and the environment
- Safely restore service

Hazardous liquid (49 CFR 195.402)

- Take necessary actions, such as emergency shutdown and pressure reduction
- Control of released hazardous liquid or carbon dioxide at scene to minimize hazards
- Minimize public exposure to injury by taking appropriate actions such as evacuations or traffic controls
- Use instrumentation to assess vapor cloud coverage and determine hazardous areas

CORE Coordinated Response Exercise®

Discussion Based Exercise

Natural Disasters

- Tornadoes
- Wildfires/Forest Fires
- Flooding/Mudslides/Slips
- Earthquakes


Human Error

- Vehicle accidents involving above ground valve sites
- Third party strikes by contractors and excavators
- Agricultural activities, field tilling

National Security Threats

- Cyberterrorism/involving pipeline systems
- IED's on pipeline assets

These training programs can also go hand in hand with Homeland Security Exercise and Evaluation Programs (HSEEP)






CORE Coordinated Response Exercise Discussion

Discussion Questions

- Pipeline Operators: How do you typically find out about an emergency, and what protocols go into effect when a product release occurs on your system that your local emergency responders may not be aware of (behind the scenes)?
- Emergency Responders: How will we deliver coordinated, prompt, reliable and actionable information to the whole community about what is happening? (Mission: Response; Public Information & Warning)
- Pipeline Operators: Do you always know where emergency responders will set up an Incident Command Post (ICP)?
- Emergency Responders: How will we establish and maintain a unified and coordinated operations structure that appropriately integrates all critical stakeholders and supports the execution of core capabilities? (Mission: Response; Operational Coordination)


CORE Coordinated Response Exercise Discussion

Discussion Questions

- Pipeline Operators: How will you get access to the scene if a secured perimeter has been established?
- Emergency Responders: How will we conduct appropriate measures to ensure the protection of the health and safety of the public and workers, as well as the environment, from all hazards in support of responder operations and the affected communities? (Mission: Response; Environmental Response / Health & Safety)
- Pipeline Operators: How will you typically handle communications?
 - At the scene between pipeline operators?
 - At the scene between pipeline operators and the ICP / other emergency responders?
 - Between field pipeline personnel and Control Centers / SCADA Centers?
- Emergency Responders: How can we ensure the capacity for timely communications in support of security, situational awareness, and operations by any and all means available, among and between affected communities in the impact area and all response forces? (Mission: Response; Operational Communications)

CORE Discussion-Based Exercise Recap

- Timely notification of the incident
- Denied entry at scene of incident
- Quick access to remote valves/ICP
- Getting equipment into the area
- Communications with incident command
- Clear lines of communication (both ways)
- Face to face meetings with local officials
- Pre-planning with emergency services



CORE National Emergency Number Association

Pipeline Emergency Operations Standard

NENA's pipeline emergency operations workgroup recommendations

- Awareness of pipelines affecting the 911 service area
- Pipeline leak recognition and initial response actions
- Additional notices to pipeline operators



Initial Intake Checklist

- Quick reference guide in program materials

Pipeline emergency operations standard/model recommendations

- Access the full report through nena.org

"Actions taken during this time frame significantly impact the effectiveness of the response and are critical to public safety"

Paradigm

CORE New PHMSA Rule – Impact on PSAPs

For both natural gas and hazardous liquids pipelines


- Rupture mitigation valves must be installed on all newly constructed and replaced pipelines 6" in diameter or greater for onshore gas transmission, Type A gas gathering and hazardous liquid pipelines
 - This does not include natural gas distribution pipelines
- Pipeline operators must contact 9-1-1 or Emergency Management with a 'notice of potential rupture'

How does this rule potentially affect PSAPs

- How will your agency process this call when notified of a 'potential' release?
 - Will you record it and not pass it on to your response agencies?
 - Will you record and pass that information on to your response agencies?
 - Will this require your PSAP (and emergency services) to develop written policies?
- Where, potentially, could this call be coming from?
 - Pipeline control center locations
 - Contacting a PSAP through the non-emergency number (no Automatic Number Identification (ANI), No Automatic Location Identification (ALI))
 - Is this number monitored 24/7?
- Pipeline operators were required to update their Emergency Response Plan (ERP) with this requirement in October 2022.

Paradigm

CORE National Pipeline Mapping System (NPMS)

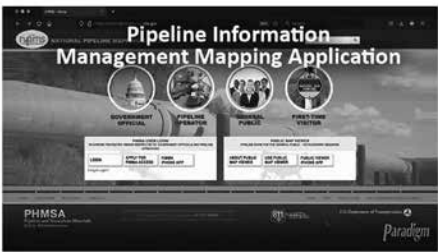

Paradigm

CORE Product Characteristics

Hazardous Liquids
ER Guide 128 (Pages 192-193)*

- Crude oil, jet fuel, gasoline and other refined products
- Liquid in and liquid out of the pipeline


Highly Volatile Liquids
ER Guide 115 (Pages 166-167)*

- Propane, Butane, Ethane and natural gas liquids
- Liquid in and vapor out of the pipeline

Natural Gas
ER Guide 115 (Pages 166-167)*

- Gas in and gas out of the pipeline
- Odorant Mercaptan added where required

*These ER Guide and page numbers are from the 2020 edition of the Emergency Response Guidebook



Paradigm

Product Characteristics Resources

Mobile Applications: Android and iPhone

- BP 2020 (OS)
 - Android: [BP 2020 \(OS\)](#)
 - iOS: [BP 2020 \(OS\)](#)
- CHEMICAL SAFETY DATA SHEETS**
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)
- CAMEO CHEMICALS**
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)
- CDC N**
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)
- SPHSH Public Version and Public Health Response App Store
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)
- NOSH Mobile Pocket Guide** (OS)
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)
- CERCLA/PCMTA
 - Android: [Android \(OS\)](#)
 - iOS: [iOS \(OS\)](#)

For 2007-08 Emergency Response, consult 49 CFR 192.462, 192.465, 192.468, 192.470, 192.471, 192.472, 192.473, 192.474, 192.475, 192.476, 192.477, 192.478, 192.479, 192.480, 192.481, 192.482, 192.483, 192.484, 192.485, 192.486, 192.487, 192.488, 192.489, 192.490, 192.491, 192.492, 192.493, 192.494, 192.495, 192.496, 192.497, 192.498, 192.499, 192.500, 192.501, 192.502, 192.503, 192.504, 192.505, 192.506, 192.507, 192.508, 192.509, 192.510, 192.511, 192.512, 192.513, 192.514, 192.515, 192.516, 192.517, 192.518, 192.519, 192.520, 192.521, 192.522, 192.523, 192.524, 192.525, 192.526, 192.527, 192.528, 192.529, 192.530, 192.531, 192.532, 192.533, 192.534, 192.535, 192.536, 192.537, 192.538, 192.539, 192.540, 192.541, 192.542, 192.543, 192.544, 192.545, 192.546, 192.547, 192.548, 192.549, 192.550, 192.551, 192.552, 192.553, 192.554, 192.555, 192.556, 192.557, 192.558, 192.559, 192.560, 192.561, 192.562, 192.563, 192.564, 192.565, 192.566, 192.567, 192.568, 192.569, 192.570, 192.571, 192.572, 192.573, 192.574, 192.575, 192.576, 192.577, 192.578, 192.579, 192.580, 192.581, 192.582, 192.583, 192.584, 192.585, 192.586, 192.587, 192.588, 192.589, 192.590, 192.591, 192.592, 192.593, 192.594, 192.595, 192.596, 192.597, 192.598, 192.599, 192.600, 192.601, 192.602, 192.603, 192.604, 192.605, 192.606, 192.607, 192.608, 192.609, 192.610, 192.611, 192.612, 192.613, 192.614, 192.615, 192.616, 192.617, 192.618, 192.619, 192.620, 192.621, 192.622, 192.623, 192.624, 192.625, 192.626, 192.627, 192.628, 192.629, 192.630, 192.631, 192.632, 192.633, 192.634, 192.635, 192.636, 192.637, 192.638, 192.639, 192.640, 192.641, 192.642, 192.643, 192.644, 192.645, 192.646, 192.647, 192.648, 192.649, 192.650, 192.651, 192.652, 192.653, 192.654, 192.655, 192.656, 192.657, 192.658, 192.659, 192.660, 192.661, 192.662, 192.663, 192.664, 192.665, 192.666, 192.667, 192.668, 192.669, 192.670, 192.671, 192.672, 192.673, 192.674, 192.675, 192.676, 192.677, 192.678, 192.679, 192.680, 192.681, 192.682, 192.683, 192.684, 192.685, 192.686, 192.687, 192.688, 192.689, 192.690, 192.691, 192.692, 192.693, 192.694, 192.695, 192.696, 192.697, 192.698, 192.699, 192.700, 192.701, 192.702, 192.703, 192.704, 192.705, 192.706, 192.707, 192.708, 192.709, 192.710, 192.711, 192.712, 192.713, 192.714, 192.715, 192.716, 192.717, 192.718, 192.719, 192.720, 192.721, 192.722, 192.723, 192.724, 192.725, 192.726, 192.727, 192.728, 192.729, 192.730, 192.731, 192.732, 192.733, 192.734, 192.735, 192.736, 192.737, 192.738, 192.739, 192.740, 192.741, 192.742, 192.743, 192.744, 192.745, 192.746, 192.747, 192.748, 192.749, 192.750, 192.751, 192.752, 192.753, 192.754, 192.755, 192.756, 192.757, 192.758, 192.759, 192.760, 192.761, 192.762, 192.763, 192.764, 192.765, 192.766, 192.767, 192.768, 192.769, 192.770, 192.771, 192.772, 192.773, 192.774, 192.775, 192.776, 192.777, 192.778, 192.779, 192.780, 192.781, 192.782, 192.783, 192.784, 192.785, 192.786, 192.787, 192.788, 192.789, 192.790, 192.791, 192.792, 192.793, 192.794, 192.795, 192.796, 192.797, 192.798, 192.799, 192.800, 192.801, 192.802, 192.803, 192.804, 192.805, 192.806, 192.807, 192.808, 192.809, 192.810, 192.811, 192.812, 192.813, 192.814, 192.815, 192.816, 192.817, 192.818, 192.819, 192.820, 192.821, 192.822, 192.823, 192.824, 192.825, 192.826, 192.827, 192.828, 192.829, 192.830, 192.831, 192.832, 192.833, 192.834, 192.835, 192.836, 192.837, 192.838, 192.839, 192.840, 192.841, 192.842, 192.843, 192.844, 192.845, 192.846, 192.847, 192.848, 192.849, 192.850, 192.851, 192.852, 192.853, 192.854, 192.855, 192.856, 192.857, 192.858, 192.859, 192.860, 192.861, 192.862, 192.863, 192.864, 192.865, 192.866, 192.867, 192.868, 192.869, 192.870, 192.871, 192.872, 192.873, 192.874, 192.875, 192.876, 192.877, 192.878, 192.879, 192.880, 192.881, 192.882, 192.883, 192.884, 192.885, 192.886, 192.887, 192.888, 192.889, 192.890, 192.891, 192.892, 192.893, 192.894, 192.895, 192.896, 192.897, 192.898, 192.899, 192.900, 192.901, 192.902, 192.903, 192.904, 192.905, 192.906, 192.907, 192.908, 192.909, 192.910, 192.911, 192.912, 192.913, 192.914, 192.915, 192.916, 192.917, 192.918, 192.919, 192.920, 192.921, 192.922, 192.923, 192.924, 192.925, 192.926, 192.927, 192.928, 192.929, 192.930, 192.931, 192.932, 192.933, 192.934, 192.935, 192.936, 192.937, 192.938, 192.939, 192.940, 192.941, 192.942, 192.943, 192.944, 192.945, 192.946, 192.947, 192.948, 192.949, 192.950, 192.951, 192.952, 192.953, 192.954, 192.955, 192.956, 192.957, 192.958, 192.959, 192.960, 192.961, 192.962, 192.963, 192.964, 192.965, 192.966, 192.967, 192.968, 192.969, 192.970, 192.971, 192.972, 192.973, 192.974, 192.975, 192.976, 192.977, 192.978, 192.979, 192.980, 192.981, 192.982, 192.983, 192.984, 192.985, 192.986, 192.987, 192.988, 192.989, 192.990, 192.991, 192.992, 192.993, 192.994, 192.995, 192.996, 192.997, 192.998, 192.999, 193.000

Petroleum Products Batching

Pipeline Products Batching

Emergency Response and 811

Derailments, car accidents, excavating/farming mishaps, natural disasters, and wildfires

PHMSA Advisory Bulletin (2012-08)

- Based on National Transportation Board recommendation
- Inform emergency responders about the benefits of 811
- Identify underground utilities in the area
- Notify underground utilities in the area

Above Ground Storage Tanks

Considerations when responding to tank farms/ terminals

Work with your local operator to:

- Develop an effective response plan
- Identify products and hazards
- Determine evacuation radius


Response recommendations:

- Cool tank(s) or nearby containers by flooding with water
- Use unmanned hose holders/monitor nozzles
- Do not direct water at safety devices or icing may occur
- Let product burn, even after air supply line/system is closed
- Beware of the potential for Boiling Liquid Expanding Vapor Explosion (BLEVE)

CORE Underground Storage Fields

Emergency response "non-intervention"

- Emergency contact information found on pipeline markers and all wellhead locations
- Always be aware of wind direction; walk into the wind, away from hazardous fumes
- Do not drive into a leak or vapor cloud
- Monitor combustible atmosphere
- Determine hazardous area and escape routes

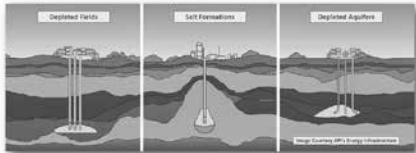

Paragon

CORE Local Distribution Systems


Caution

- Be aware, not all natural gas leaks are from excavation, unintended leaks from stoves, water heaters, furnaces, etc. can occur
- When called out on natural gas leak events, use combustible gas indicators
- Mercaptan can be stripped as it travels through soil
- Frost heaves, breaking pipes
- Gas meter breaks due to snow buildup from melting snow falling from roofs

Excess flow valve meter tags

Identification tags [192.383(c)]

- The presence of an excess flow valve on the service lines must be marked with an identification tag. The identification tag will typically be located at the top of the service riser below the meter stop valve



Paragon

CORE Excess Flow Valve (EFV)

Local Distribution Lines


- Automatic reduction of gas flow should a service line break
- May not completely stop the flow of natural gas
- May not hear a distinct hissing sound
- Migration and ignition sources may still exist
- Always work a coordinated response with your local operator
- Not all service lines have an EFV installed



Paragon

CORE Explosive Limits

Explosive Limits vs. Percent of Gas in Air

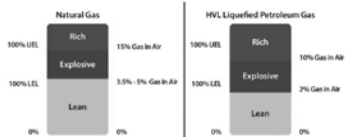

Lower / Upper explosive limits depend on characteristics of specific products

Paragon

Farm Taps

- Mainly in rural areas, some natural gas pipeline companies may have facilities commonly referred to as "farm taps"
- These natural gas settings are made up of valves, pipes, regulators, relief valves and a meter. It may be located near the home or within the general vicinity
- To report the smell of gas near a farm tap, call 911 and the local gas distribution company from a safe distance.
- The lines after a farm tap or residential meter are PRIVATE LINES. Be aware of these.



InfraGard – Protecting Critical Infrastructure

InfraGard is a partnership between the FBI and members of the private sector for the protection of U.S. Critical Infrastructure.



THOUSANDS OF MEMBERS, ONE MISSION:
Protecting critical infrastructure, the foundation of American life.

<https://infogard.org>

16 Critical Infrastructure Sectors:

- Chemical
- Commercial Facilities
- Communications
- Critical Manufacturing
- Dams
- Defense Industrial Base
- Emergency Services
- Energy
- Financial Services
- Food and Agriculture
- Government Facilities
- Healthcare and Public Health
- Information Technology
- Nuclear Reactors, Materials, and Waste
- Transportation Services
- Water & Wastewater Systems


Emergency Response Portal (ERP)

PHMSA Advisory Bulletin issued October 2010
<https://www.spatiaobjects.com/admin/regions/ERP>

Provides agencies secure access to participating pipeline operator profiles include:*

- Contact information
- Counties of operation
- Product(s) transported

*Additional information updated to share pipeline mapping, emergency response plans.

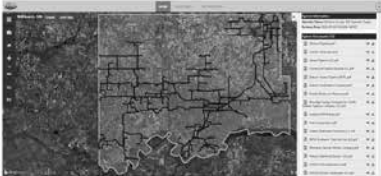

Pipeline Preparedness Training Center

Share with others in your agency unable to attend today's program

- Access to your local pipeline sponsor information
- Download the same documents presented in this program
- Certificate of completion provided upon completion of course

trainingcenter.pdigm.com
Use Code: 2024CORE

911 Communications Director: Appreciate the opportunity to do this online and have it available for my staff. Very informative!

Battalion Chief: Thank you for the information! I also like the fact of being able to take the course online when I cannot make the live sessions.

Commissioner: Very informative and increased my awareness of the resources available to our county leadership in case of an emergency.

Deputy Emergency Management Coordinator: Excellent presentation, Thank you for the resources and useful web pages.

Director of Public Safety: Excellent presentation, Thank you for the ability to take class online due to scheduling conflict.

Fire Chief: Thank you for providing this informative course. I would like to see more courses like this. It is a very good review and helps us tremendously.

Police Chief: The training is very informative, and I will pass this onto our Fire Department and our Law Enforcement Supervisors. Great job!!!

Program content and slides subject to change

10

Product INFORMATION



The Emergency Response Guidebook is available at:

<https://www.phmsa.dot.gov/sites/phmsa.dot.gov/files/2021-01/ERG2020-WEB.pdf>



This app is only available on the App Store for iOS devices.

EMERGENCY RESPONSE PLANS FOR GAS AND HAZARDOUS LIQUID PIPELINE OPERATORS

Federal regulations for both gas and hazardous liquid pipelines require operators to have written procedures for responding to emergencies involving their pipeline facility. Because pipelines are often located in public space, the regulations further require that operators include procedures for planning with emergency and other public officials to ensure a coordinated response. Please contact your local pipeline operators for information regarding their company specific emergency response plan.

Natural Gas

Each operator shall establish written procedures to minimize the hazard resulting from a gas pipeline emergency. At a minimum, the procedures must provide for the following:

- Receiving, identifying, and classifying notices of events which require immediate response by the operator.
- Establishing and maintaining adequate means of communication with appropriate fire, police, and other public officials.
- Prompt and effective response to a notice of each type of emergency, including the following:
 1. Gas detected inside or near a building.
 2. Fire located near or directly involving a pipeline facility.
 3. Explosion occurring near or directly involving a pipeline facility.
 4. Natural disaster.
- The availability of personnel, equipment, tools, and materials, as needed at the scene of an emergency.
- Actions directed toward protecting people first and then property.
- Emergency shutdown and pressure reduction in any section of the operator's pipeline system necessary to minimize hazards to life or property.
- Making safe any actual or potential hazard to life or property.
- Notifying appropriate fire, police, and other public officials of gas pipeline emergencies and coordinating with them both planned responses and actual responses during an emergency.
- Safely restoring any service outage.
- Each operator shall establish and maintain liaison with appropriate fire, police, and other public officials to:
 1. Learn the responsibility and resources of each government organization that may respond to a gas pipeline emergency;
 2. Acquaint the officials with the operator's ability in responding to a gas pipeline emergency;
 3. Identify the types of gas pipeline emergencies of which the operator notifies the officials; and
 4. Plan how the operator and officials can engage in mutual assistance to minimize hazards to life or property.

**Reference 49 CFR 192.615*



HAZARDOUS LIQUIDS

(a) General: Each operator shall prepare and follow for each pipeline system a manual of written procedures for conducting normal operations and maintenance activities and handling abnormal operations and emergencies. This manual shall be reviewed at intervals not exceeding 15 months, but at least once each calendar year, and appropriate changes made as necessary to insure that the manual is effective. This manual shall be prepared before initial operations of a pipeline system commence, and appropriate parts shall be kept at locations where operations and maintenance activities are conducted.

Emergencies. The manual required by paragraph (a) of this section must include procedures for the following to provide safety when an emergency condition occurs:

- Receiving, identifying, and classifying notices of events which need immediate response by the operator or notice to fire, police, or other appropriate public officials and communicating this information to appropriate operator personnel for corrective action.
- Prompt and effective response to a notice of each type emergency, including fire or explosion occurring near or directly involving a pipeline facility, accidental release of hazardous liquid or carbon dioxide from a pipeline facility, operational failure causing a hazardous condition, and natural disaster affecting pipeline facilities.
- Having personnel, equipment, instruments, tools, and material available as needed at the scene of an emergency.
- Taking necessary action, such as emergency shutdown or pressure reduction, to minimize the volume of hazardous liquid or carbon dioxide that is released from any section of a pipeline system in the event of a failure.
- Control of released hazardous liquid or carbon dioxide at an accident scene to minimize the hazards, including possible intentional ignition in the cases of flammable highly volatile liquid.
- Minimization of public exposure to injury and probability of accidental ignition by assisting with evacuation of residents and assisting with halting traffic on roads and railroads in the affected area, or taking other appropriate action.
- Notifying fire, police, and other appropriate public officials of hazardous liquid or carbon dioxide pipeline emergencies and coordinating with them preplanned and actual responses during an emergency, including additional precautions necessary for an emergency involving a pipeline system transporting a highly volatile liquid.
- In the case of failure of a pipeline system transporting a highly volatile liquid, use of appropriate instruments to assess the extent and coverage of the vapor cloud and determine the hazardous areas.
- Providing for a post accident review of employee activities to determine whether the procedures were effective in each emergency and taking corrective action where deficiencies are found.

**Reference 49 CFR 195.402*

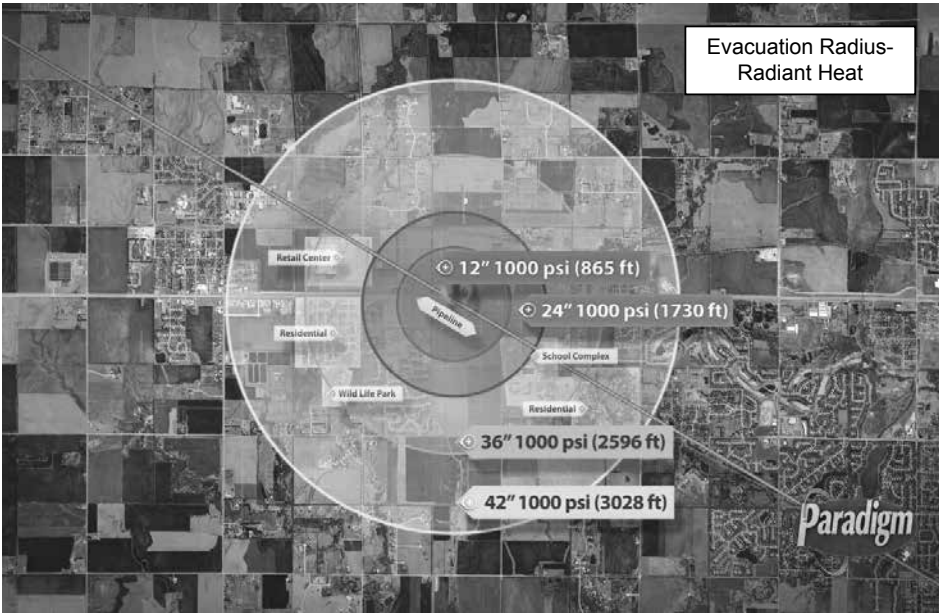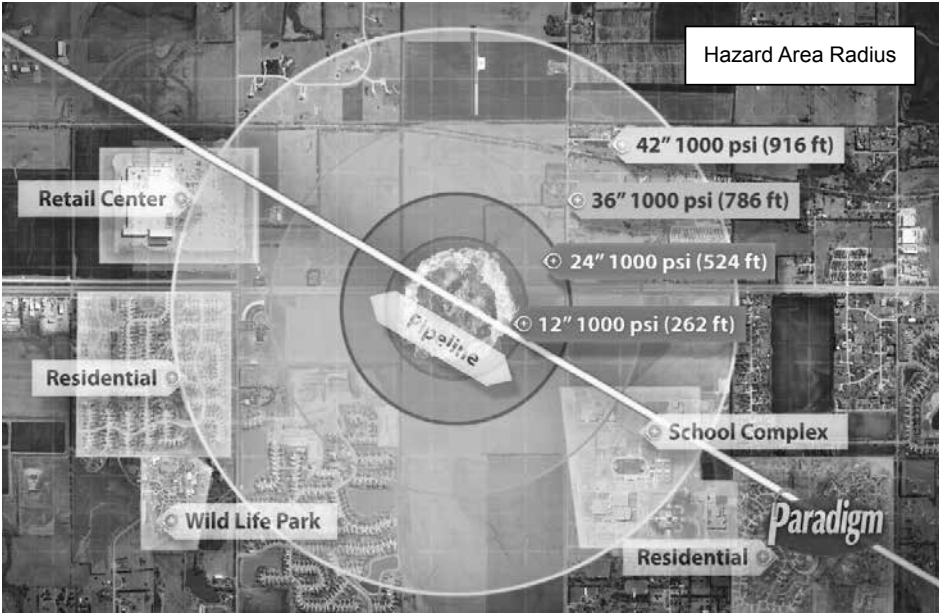

In accordance with NENA Pipeline Emergency Operations Standard/Model Recommendation NENA 56-007 (<https://www.nena.org/?page=PipelineEmergStd>)

GOALS FOR INITIAL INTAKE:

1. Obtain and Verify Incident Location, Callback and Contact Information
2. Maintain Control of the Call
3. Communicate the Ability to HELP the Caller
4. Methodically and Strategically Obtain Information through Systematic Inquiry to be Captured in the Agency's Intake Format
5. Recognize the potential urgency of situations involving the release of dangerous gases or liquids related to pipelines or similar events of this nature and immediately begin the proper notifications consistent with agency policy
6. Perform all Information Entries and Disseminations, Both Initial and Update

FIRST RESPONSE CALL INTAKE CHECK LIST

The focus of this Standard is on the first minute of the call intake process. Actions taken during this time frame significantly impact the effectiveness of the response and are critical to public safety.

The following protocol is intended as a solid framework for call intake, but should not in any manner rescind or override agency procedures for the timing of broadcasts and messaging.

These procedures are established as recommended practices to consider with existing agency policy and procedure to ensure the most swift and accurate handling of every incident involving the release of dangerous gases or hazardous liquids.

All information should be simultaneously entered, as it is obtained by the telecommunicator, into an electronic format (when available) that will feed/populate any directed messages which will be sent to emergency responders in conjunction with on-air broadcasts.

Location:

Request exact location of the incident (structure addresses, street names, intersections, directional identifiers, mile posts, etc.) and obtain callback and contact information.

Determine Exactly What Has Happened:

Common signs of a pipeline leak are contained in Table 1 below. If any of these conditions are reported, THIS IS A PIPELINE EMERGENCY.

**TABLE 1
Common Indications of a Pipeline Leak**

| Condition | Natural Gas (lighter than air) | LPG & HVL (heavier than air) | Liquids |
|--|-----------------------------------|---------------------------------|---------|
| An odor like rotten eggs or a burnt match | X | X | |
| A loud roaring sound like a jet engine | X | X | |
| A white vapor cloud that may look like smoke | | X | |
| A hissing or whistling noise | X | X | |
| The pooling of liquid on the ground | | | X |
| An odor like petroleum liquids or gasoline | | X | X |
| Fire coming out of or on top of the ground | X | X | |
| Dirt blowing from a hole in the ground | X | X | |
| Bubbling in pools of water on the ground | X | X | |
| A sheen on the surface of water | | X | X |
| An area of frozen ground in the summer | X | X | |
| An unusual area of melted snow in the winter | X | X | |
| An area of dead vegetation | X | X | X |

Signs Of A Pipeline Release

SIGHT*

- Liquid on the ground
- Rainbow sheen on water
- Dead vegetation in an otherwise green area
- Dirt blowing into the air
- White vapor cloud
- Frozen area on ground

*Signs vary based upon product

SMELL

- Odors such as gas or oil
- Natural gas is colorless and odorless
 - Unless Mercaptan has been added (*rotten egg odor*)

OTHER - NEAR PIPELINE OPERATIONS

- Burning eyes, nose or throat
- Nausea

SOUND

- A hissing or roaring sound

What To Do If A Leak Occurs

- Evacuate immediately upwind
- Eliminate ignition sources
- Advise others to stay away
- **CALL 911** and the pipeline company – number on warning marker
 - Call collect if necessary
- Make calls from safe distance – not “hot zone”
- Give details to pipeline operator:
 - Your name
 - Your phone number
 - Leak location
 - Product activity
 - Extent of damage
- DO NOT drive into leak or vapor cloud
- DO NOT make contact with liquid or vapor
- DO NOT operate pipeline valves (*unless directed by pipeline operator*):
 - Valve may be automatically shut by control center
 - Valve may have integrated shut-down device
 - Valve may be operated by qualified pipeline personnel only, unless specified otherwise
- Ignition sources may vary – a partial list includes:
 - Static electricity
 - Metal-to-metal contact
 - Pilot lights
 - Matches/smoking
 - Sparks from telephone
 - Electric switches
 - Electric motors
 - Overhead wires
 - Internal combustion engines
 - Garage door openers
 - Firearms
 - Photo equipment
 - Remote car alarms/door locks
 - High torque starters – diesel engines
 - Communication devices

Pipeline Emergency

Call Gas Control Or Pipeline Control Center

Use **Pipeline Emergency Response Planning**

Information Manual for contact information

Phone number on warning markers

Use state One-Call System, if applicable

Control Center Needs To Know

Your name & title in your organization

Call back phone number – primary, alternate

Establish a meeting place

Be very specific on the location (**use GPS**)

Provide City, County and State

Injuries, Deaths, Or Property Damage

Have any known injuries occurred?

Have any known deaths occurred?

Has any severe property damage occurred?

Traffic & Crowd Control

Secure leak site for reasonable distance

Work with company to determine safety zone

No traffic allowed through any hot zone

Move sightseers and media away

Eliminate ignition sources

Fire

Is the leak area on fire?

Has anything else caught on fire besides the leak?

Evacuations

Primary responsibility of emergency agency

Consult with pipeline/gas company

Fire Management

Natural Gas – DO NOT put out until supply stopped

Liquid Petroleum – water is NOT recommended; foam IS recommended

Use dry chemical, vaporizing liquids, carbon dioxide

Ignition Sources

Static electricity (*nylon windbreaker*)

Metal-to-metal contact

Pilot lights, matches & smoking, sparks from phone

Electric switches & motors

Overhead wires

Internal combustion engines

Garage door openers, car alarms & door locks

Firearms

Photo equipment

High torque starters – diesel engines

Communication devices – not intrinsically safe

Pipeline safety regulations use the concept of “High Consequence Areas” (HCAs), to identify specific locales and areas where a release could have the most significant adverse consequences. Once identified, operators are required to devote additional focus, efforts, and analysis in HCAs to ensure the integrity of pipelines.

Releases from pipelines can adversely affect human health and safety, cause environmental degradation, and damage personal or commercial property. Consequences of inadvertent releases from pipelines can vary greatly, depending on where the release occurs, and the commodity involved in the release.

What criteria define HCAs for pipelines?

Because potential consequences of natural gas and hazardous liquid pipeline releases differ, criteria for HCAs also differ. HCAs for natural gas transmission pipelines focus solely on populated areas. (Environmental and ecological consequences are usually minimal for releases involving natural gas.) Identification of HCAs for hazardous liquid pipelines focuses on populated areas, drinking water sources, and unusually sensitive ecological resources.

HCAs for hazardous liquid pipelines:

- Populated areas include both high population areas (called “urbanized areas” by the U.S. Census Bureau) and other populated areas (areas referred to by the Census Bureau as a “designated place”).
- Drinking water sources include those supplied by surface water or wells and where a secondary source of water supply is not available. The land

area in which spilled hazardous liquid could affect the water supply is also treated as an HCA.

- Unusually sensitive ecological areas include locations where critically imperiled species can be found, areas where multiple examples of federally listed threatened and endangered species are found, and areas where migratory water birds concentrate.

HCAs for natural gas transmission pipelines:

- An equation has been developed based on research and experience that estimates the distance from a potential explosion at which death, injury or significant property damage could occur. This distance is known as the “potential impact radius” (or PIR), and is used to depict potential impact circles.
- Operators must calculate the potential impact radius for all points along their pipelines and evaluate corresponding impact circles to identify what population is contained within each circle.
- Potential impact circles that contain 20 or more structures intended for human occupancy; buildings housing populations of limited mobility; buildings that would be hard to evacuate. (Examples are nursing homes, schools); or buildings and outside areas occupied by more than 20 persons on a specified minimum number of days each year, are defined as HCA’s.

* <https://primis.phmsa.dot.gov/comm/FactSheets/FSHCA.htm>

Identified Sites*

Owners and companies of gas transmission pipelines are regulated by the US Department of Transportation (DOT). According to integrity management regulations, gas pipeline companies are required to accept the assistance of local public safety officials in identifying certain types of sites or facilities adjacent to the pipeline which meets the following criteria:

- (a) A small, well-defined outside area that is occupied by twenty or more persons on at least 50 days in any twelve-month period (the days need not be consecutive). Examples of such an area are playgrounds, parks, swimming pools, sports fields, and campgrounds.
- (b) A building that is occupied by 20 or more persons on at least 5 days a week for 10 weeks in any 12 month period (the days and weeks need not be consecutive). Examples included in the definition are: religious facilities, office buildings, community centers, general stores, 4-H facilities, and roller rinks.
- (c) A facility that is occupied by persons who are confined, are of impaired mobility, or would be difficult to evacuate. Examples of such a facility are hospitals, schools, elder care, assisted living/nursing facilities, prisons and child daycares.

Identified Site Registry

Pipeline operators need your help keeping people and property safe.

Identified Sites - locations where many people occupy an area near a pipeline asset or facility. These are places where people may gather from time to time for a variety of reasons.

Some of these sites are very difficult for companies to obtain without help from those with local knowledge of the area.

Please use the following website to gain secure access, so you can assist in identifying sites where people congregate in your community:

my.spatialobjects.com/admin/register/ISR

Pipeline operators are required by law to work with public officials who have safety or emergency response, or planning responsibilities that can provide quality information regarding identified sites.



* 49 CFR §192.903.

In 1999, the Department of Transportation sponsored the Common Ground Study. The purpose of the Common Ground Study was to identify and validate existing best practices performed in connection with preventing damage to underground facilities. The collected best practices are intended to be shared among stakeholders involved with and dependent upon the safe and reliable operation, maintenance, construction, and protection of underground facilities. The best practices contain validated experiences gained that can be further examined and evaluated for possible consideration and incorporation into state and private stakeholder underground facility damage prevention programs.

The current Best Practices Field Manual is divided into nine chapters that provide a collection of current damage prevention best practices. The nine chapters include:

1. Planning & Design Best Practices
2. One Call Center Best Practices
3. Location & Marking Best Practices
4. Excavation Best Practices
5. Mapping Best Practices
6. Compliance Best Practices
7. Public Education Best Practices
8. Reporting & Evaluation Best Practices
9. Miscellaneous Practices

To view the latest version of the Best Practices please visit www.commongroundalliance.com



Pipelines In Our Community

According to National Transportation Safety Board statistics pipelines are the safest and most efficient means of transporting natural gas and petroleum products, which are used to supply roughly two-thirds of the energy we use. These pipelines transport trillions of cubic feet of natural gas and hundreds of billions of ton/miles of liquid petroleum products in the United States each year.

This system is comprised of three types of pipelines: transmission, distribution and gathering. The approximately 519,000 miles of transmission pipeline* transport products, including natural gas and petroleum products, across the country and to storage facilities. Compressor stations and pumping stations are located along transmission and gathering pipeline routes and help push these products through the line.

Approximately 2.2 million miles of distribution pipeline* is used to deliver natural gas to most homes and businesses through underground main and utility service lines. Onshore gathering lines are pipelines that transport gas from a current production operation facility to a transmission line or main. Production operations are piping and equipment used in production and preparation for transportation or delivery of hydrocarbon gas and/or liquids.

*mileage according to the Pipeline Hazardous Materials Safety Administration (PHMSA).



**Know what's below.
Call before you dig.**

Training Center

Supplemental training available for agencies and personnel that are unable to attend:

- Train as your schedule allows
- Download resources including pipeline operator specific information
 - Sponsoring pipeline operator contact information
 - Product(s) transported
- Submit Agency Capabilities Survey
- Receive Certificate of Completion

Visit <https://trainingcenter.pdigm.com/> to register for training



Damage Prevention Programs

Pursuant to 49 CFR Parts 192.614 (c)(2)(i) and 195.442 (c)(2)(i) pipeline operators must communicate their Damage Prevention Program's "existence and purpose" to the public in the vicinity of the pipeline and persons who normally engage in excavation activities in the area in which the pipeline is located.

State and federally regulated pipeline companies maintain Damage Prevention Programs. The purpose of which is to prevent damage to pipelines and facilities from excavation activities, such as digging, trenching, blasting, boring, tunneling, backfilling, or by any other digging activity.

Pipeline Markers

The U.S. Department of Transportation (DOT) requires the use of signs to indicate the location of underground pipelines. Markers like these are located on road, railroad, and navigable waterway crossings. Markers are also posted along the pipeline right-of-way.

The markers display:

- The material transported
- The name of the pipeline operator
- The operator's emergency number

MARKER INFORMATION

- Indicates area of pipeline operations
- May have multiple markers in single right-of-way
- May have multiple pipelines in single right-of-way
- DOES NOT show exact location
- DOES NOT indicate depth (*never assume pipeline depth*)
- DOES NOT indicate pipeline pressure











Call Before You Dig

Statistics indicate that damage from excavation related activities is a leading cause of pipeline accidents. If you are a homeowner, farmer, excavator, or developer, we need your help in preventing pipeline emergencies.

1. Call your state's One-Call center before excavation begins - regulatory mandate as state law requires.
2. Wait the required amount of time.
3. A trained technician will mark the location of the pipeline and other utilities (private lines are not marked).
4. Respect the marks.
5. Dig with care.

American Public Works Association (APWA) Uniform Color Code

| | |
|---|---|
|  | WHITE - Proposed Excavation |
|  | PINK - Temporary Survey Markings |
|  | RED - Electric Power Lines, Cables, Conduit and Lighting Cables |
|  | YELLOW - Gas, Oil, Steam, Petroleum or Gaseous Materials |
|  | ORANGE - Communication, Alarm or Signal Lines, Cables or Conduit |
|  | BLUE - Potable Water |
|  | PURPLE - Reclaimed Water, Irrigation and Slurry Lines |
|  | GREEN - Sewers and Drain Lines |

National One-Call Dialing Number:



For More Details Visit: www.call811.com

Pipeline Damage Reporting Law As Of 2007

H.R. 2958 Emergency Alert Requirements

Any person, including a government employee or contractor, who while engaged in the demolition, excavation, tunneling, or construction in the vicinity of a pipeline facility;

- A. Becomes aware of damage to the pipeline facility that may endanger life or cause serious bodily harm or damage to property; or
- B. Damages the pipeline facility in a manner that may endanger life or cause serious bodily harm or damage to property, shall promptly report the damage to the operator of the facility and to other appropriate authorities.

Websites:

Association of Public-Safety Communications Officials - International (APCO)
www.apcointl.org/

Common Ground Alliance
www.commongroundalliance.com

Federal Emergency Management Agency
www.fema.gov

Federal Office of Pipeline Safety
www.phmsa.dot.gov

Government Emergency Telecommunications
www.dhs.gov/government-emergency-telecommunications-service-gets

Infrastructure Protection – NIPC
www.dhs.gov/national-infrastructure-protection-plan

National Emergency Number Association
<https://www.nena.org/>

National Fire Protection Association (NFPA)
www.nfpa.org

National Pipeline Mapping System
www.npms.phmsa.dot.gov

National Response Center
<https://www.epa.gov/emergency-response/national-response-center> or 800-424-8802

Paradigm Liaison Services, LLC
www.pdigm.com

United States Environmental Protection Agency (EPA)
www.epa.gov/cameo

Wireless Information System for Emergency Responders (WISER)
<https://wiser.nlm.nih.gov/>

FOR MORE INFORMATION ON THE NASFM PIPELINE EMERGENCIES PROGRAM
www.pipelineemergencies.com

**FOR EMERGENCY RESPONSE INFORMATION, REFER TO DOT GUIDEBOOK.
FOR COPIES: (202) 366-4900**
www.phmsa.dot.gov/hazmat/erg/emergency-response-guidebook-erg



Register for access to
Training Center
Code: 2024CORE



Register for access
to the Emergency
Response Portal



Paradigm is public awareness. We provide public awareness and damage prevention compliance services to assist with the regulatory requirements of 49 CFR 192 and 195, as well as API RP 1162. Since 2001, the oil and gas industry has worked with Paradigm to fulfill public education and community awareness requirements.

Our history of implementing public awareness programs and compliance services pre-dates API RP 1162. Most of the pipeline industry's large, mid-sized and small operators, as well as many local distribution companies utilize Paradigm's compliance services.

In serving our clients, Paradigm performs full-scope compliance programs from audience identification through effectiveness measurement. In addition, we offer consulting services for plan evaluation and continuous improvement. At the completion of each compliance program, we provide structured documentation which precisely records all elements of the program's implementation to assist with audits.

Paradigm leads the way in industry service. Pipeline operators and local distribution companies trust in Paradigm to implement their public awareness and damage prevention programs. Each year we:

- Distribute 25 million pipeline safety communications
- Compile and analyze roughly 250,000 stakeholder response surveys
- Facilitate over 1,200 liaison programs
- Implement approximately 1,000 public awareness compliance programs
- Provide audit support and assistance with over 50 public awareness audits

Contact Paradigm for more information regarding custom public awareness solutions.

Contact us:

Paradigm Liaison Services, LLC
PO Box 9123
Wichita, KS 67277
(877) 477-1162
Fax: (888) 417-0818
www.pdigm.com



Operator Information

| Operator Name(s) / Contact Information | Type(s) of Pipeline Systems Operating | Location within County | Pipe Size and Operating Pressure Range(s) | Average Emergency Response Time(s) |
|--|---------------------------------------|------------------------|---|------------------------------------|
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

UNDERGROUND SERVICE ALERT

— NORTHERN CALIFORNIA & NEVADA —

UNDERGROUND SERVICE ALERT OF NORTHERN CALIFORNIA AND NEVADA

USA North 811 provides a free and effective Damage Prevention service that protects the communities and underground facilities in Central and Northern California, as well as the entire state of Nevada.

USA North 811 began operation in May of 1975 and incorporated as a Non-Profit Mutual Benefit Corporation in 1986. Our objective is to receive planned excavation reports from public or private excavators and to transmit those planned excavation reports to all participating members of USA North who may have facilities at that excavation site. Our members will:

1. Mark or stake the horizontal path of their facility, or
2. Provide information about the location of their facility, or
3. Advise the excavator of clearance for facilities that they own.

For more information visit our website at www.usanorth811.org.



UNDERGROUND SERVICE ALERT OF SOUTHERN CALIFORNIA

Underground Service Alert of Southern California, aka DigAlert, is the Free Notification Center for anyone digging in the following nine Southern California counties – Inyo, Imperial, Los Angeles, Orange, Riverside, San Bernardino, San Diego, Santa Barbara and Ventura.

For more information visit our website at www.digalert.org.

CALIFORNIA

Underground Service Alert of Northern California and Nevada:
811 or 800-642-2444

Website: www.usanorth811.org

Hours: Open 24 hours a day, seven days a week

Advance Notice: 2 working days, not counting the date of notification, up to 14 calendar days

Marks Valid: 28 days (1 year for ACE tickets)

Law Link: <https://usanorth811.org/services/law-update>

*DOT exempt

| TICKETS | | | STATE LAWS & PROVISIONS | | | | | | | | NOTIFICATION EXEMPTIONS | | | | NOTIFICATIONS ACCEPTED | | | | | | | |
|---------|--------|--------|-------------------------|-----------------|------------------|----------------------|--------------------------|--------------------|-------------------|-----------------|-------------------------|-----|-----------|----------|------------------------|-------|--------|--------|-----------|----------|----------------|----------------|
| FAX | Online | Mobile | Statewide Coverage | Civil Penalties | Emergency Clause | Mandatory Membership | Excavator Permits Issued | Mandatory Premarks | Positive Response | Hand Dig Clause | Damage Reporting | DOT | Homeowner | Railroad | Agriculture | Depth | Damage | Design | Emergency | Overhead | Large Projects | Tolerance Zone |
| N | Y | Y | N | Y | Y | Y* | Y | Y | Y | Y | Y | N | Y | N | N | N | Y | N | Y | N | N | 24" |

Underground Service Alert of Southern California: 811 or 800-422-4133

Website: www.digalert.org

Hours: 6:00 AM - 7:00 PM, M-F

Advance Notice: 2 working days, not counting the date of notification, up to 14 calendar days

Marks Valid: 28 days (1 year for ACE tickets)

Law Link: <https://www.digalert.org/calaw>

*DOT exempt

| | | | | | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|----|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|-----|
| N | Y | Y | N | Y | Y | Y* | Y | Y | Y | Y | Y | N | Y | N | N | N | Y | N | Y | N | N | 24" |
|---|---|---|---|---|---|----|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|-----|

Chart Reference: <https://pipelineawareness.org/media/1507/2019-excavation-safety-guide-pipeline-edition.pdf>



1.877.477.1162 • ca.pipeline-awareness.com